





A suspended light structure carries the lighting equipment. During the daytime the lobby is lit by daylight, with the wall behind the reception desk illuminated by wallwashers and the entrance accentuated by downlights. The area beneath the first floor ceiling is illuminated using surface-mounted downlights.


The accent lighting is maintained at night, and is supplemented by an illumination of the room surfaces by indirect luminaires mounted on the light structure. The reception desk has received individual lighting from task lights.




Light structure with integral indirect luminaires for fluorescent lamps and integral track to take wallwashers.



Recessed downlight for low-voltage halogen lamps.





Surface-mounted downlight for compact fluorescent lamps.








Task light for compact fluorescent lamps.


The luminaires are mounted on a load-bearing lattice beam with integral track. The reception desk is accentuated by spotlights, the entrance by downlights. Ambient lighting and the accentuating of architectural structures is effected by flush-mounted ceiling panels with wall-washers. The waiting area beneath the first floor ceiling is illuminated by wall-washers mounted on a track recessed in the ceiling.

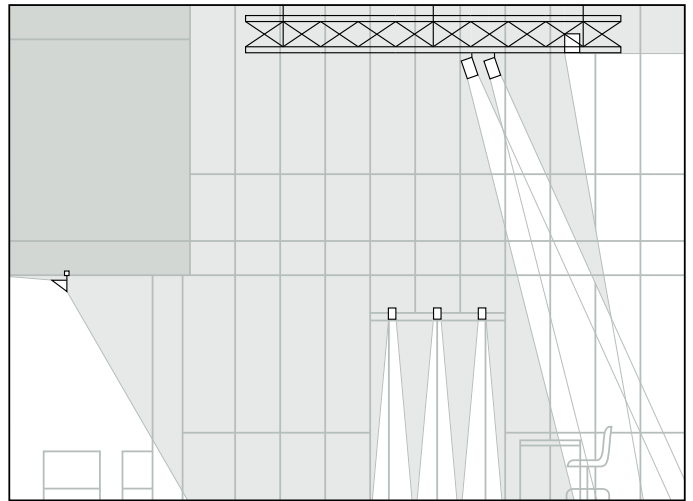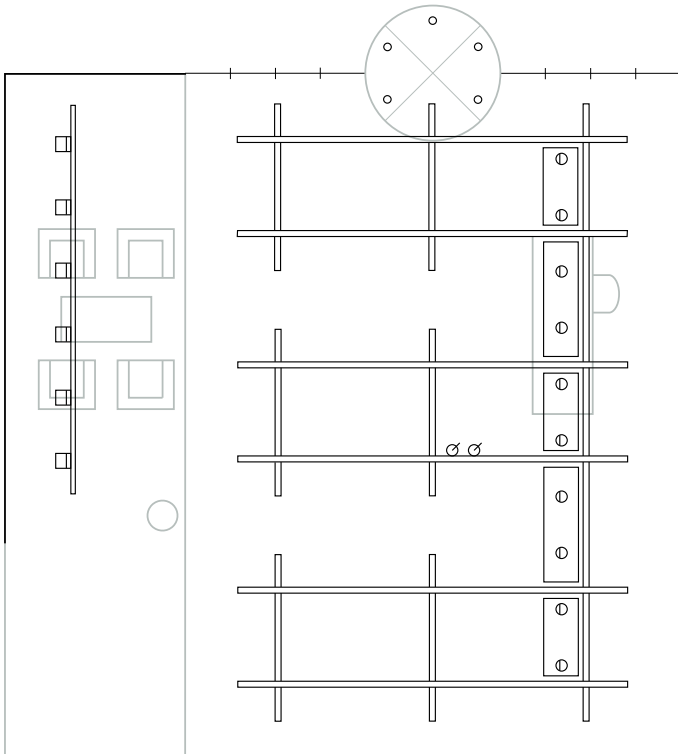

Load-bearing lattice beam with integral track to take spotlights or panels with wall-washers equipped with PAR 38 reflector lamps.



Track for wallwashers for halogen lamps.



Recessed downlight for low-voltage halogen lamps.